
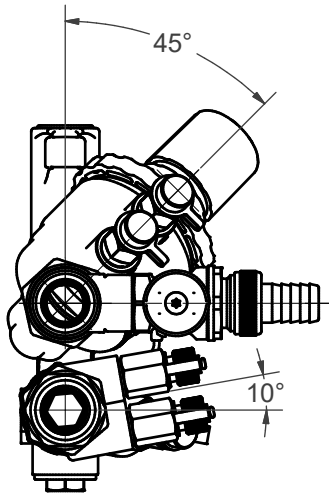
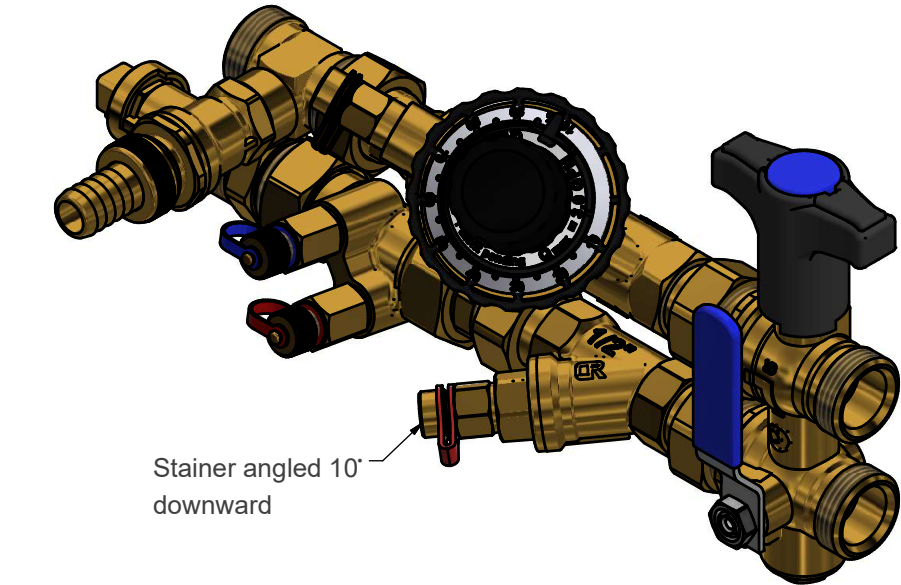
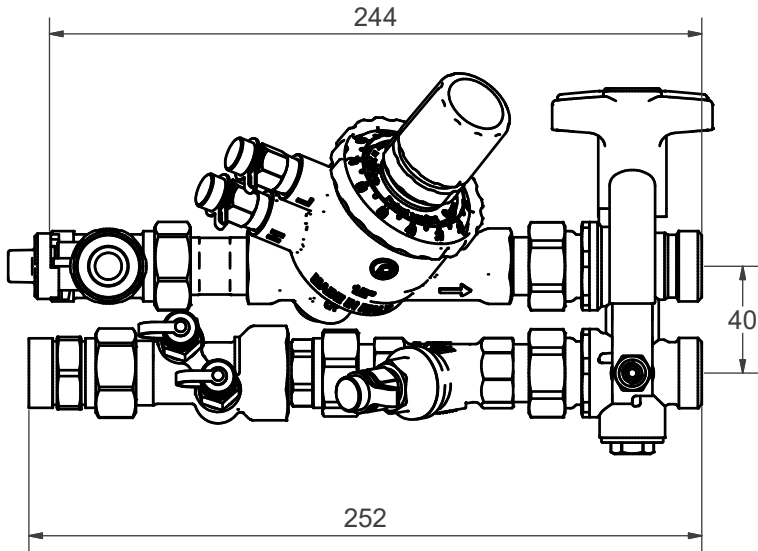






Assembly		
Type	PICV	Venturi [mm]
0X4B1RCLAS	PEB91VL.04	3
0X4B2RCLBS	PEB91L.04	4.25
0X4B2RCLCS	PEB91L.04	6
0X4B3RCLDS	PEB91H.04	7.5

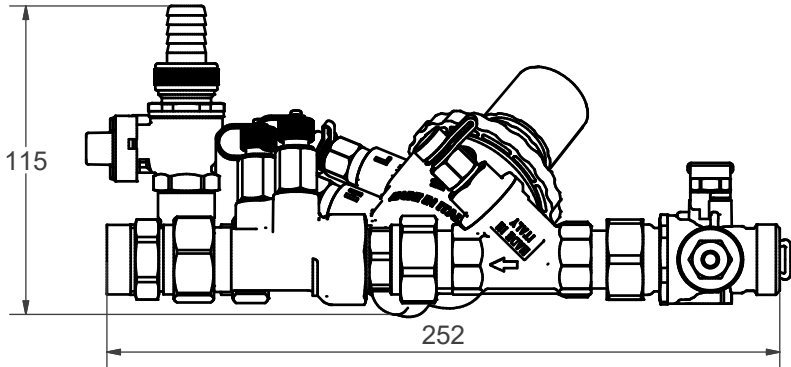

REVISION HISTORY		
REV	DESCRIPTION	DATE
A		08/10/2019
B	Moved Drain to return	25/11/2020

		Revision	B	Issued	08/10/2019
Discription					
0X4 1/2" PICV & Drain in the Return, Venturi & Strainer on flow, Cooling, Left, Vertical.					
		Drawing No.			
		0X4BxRCLxS			
Drawn By		Sheet No		All Dim's in mm, General Tolerances Unless Stated. Dim's in Whole Units Toleranced $\pm 2.00\text{mm}$ Per Joint. Assembly To Be Leak Tested Underwater To 6 Bar Air.	
AC		1 of 2			

Assembly		
Type	PICV	Venturi [mm]
0X4B4RCLES	PEB91L.06	9
0X4B5RCLFS	PEB91H.06	10.5

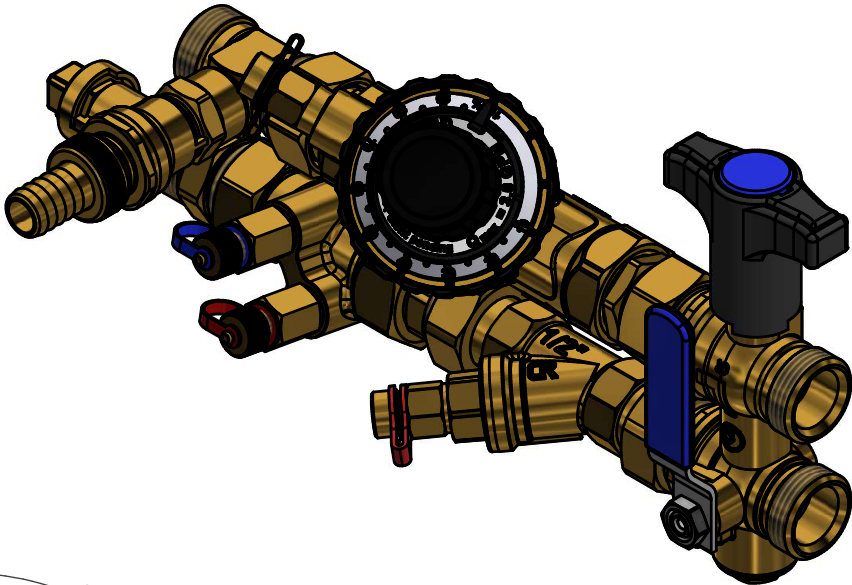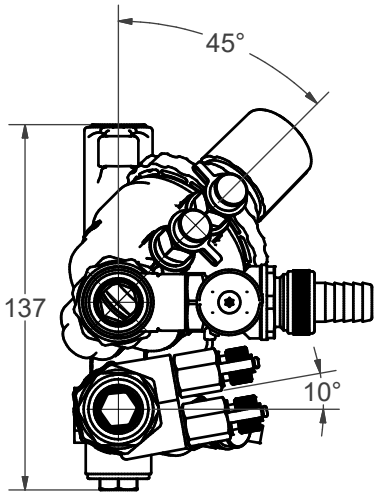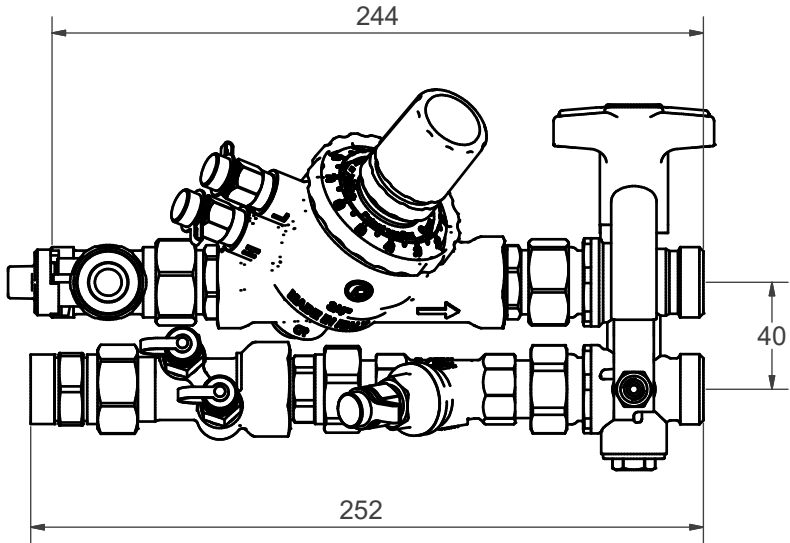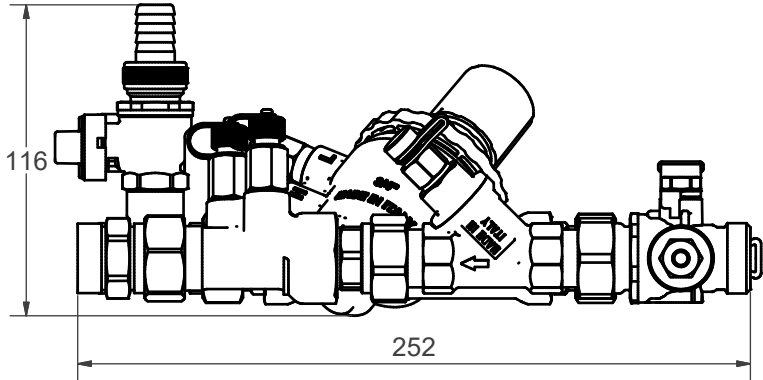

Revision	B	Issued	08/10/2019
----------	---	--------	------------

Discription	0X4 3/4" PICV & Drain in the Return, Venturi & Strainer on flow, Cooling, Left, Vertical.		
-------------	---	--	--

 PETTINAROLI UK LTD RIVERSIDE UNIT K AUSTIN WAY, HAMSTEAD IND. ESTATE, BIRMINGHAM, B42 1DU. TEL: 0121 358 2012	Drawing No.		0X4BxRCLxS (3-4)
	Drawn By	AC	Sheet No 2 of 2 All Dim's in mm, General Tolerances Unless Stated. Dim's in Whole Units Toleranced ± 2.00mm Per Joint. Assembly To Be Leak Tested Underwater To 6 Bar Air.