
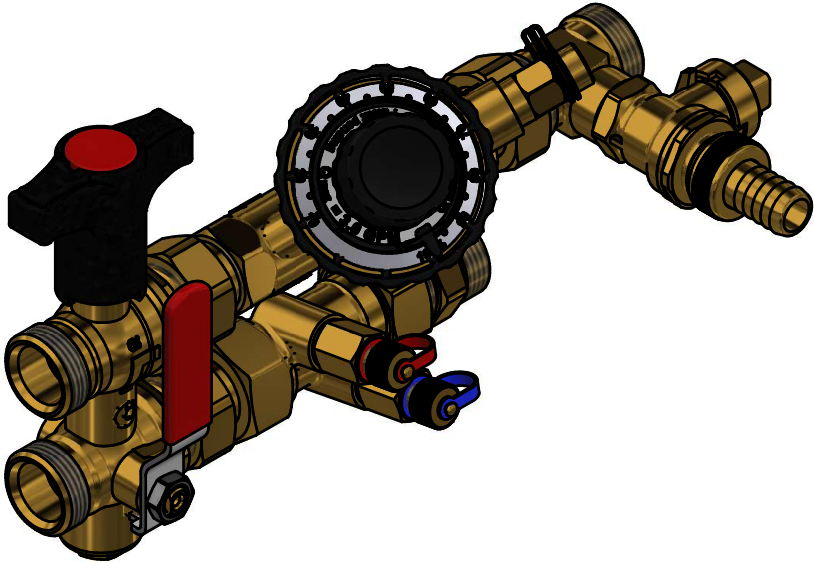
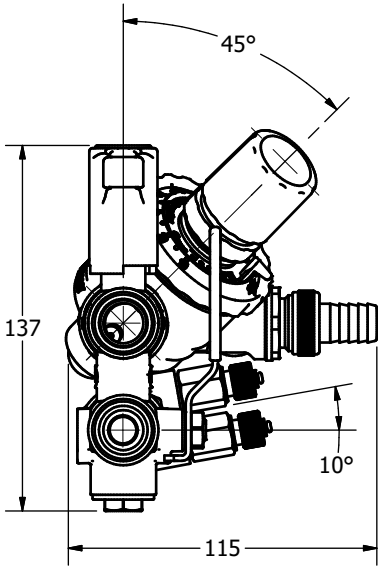
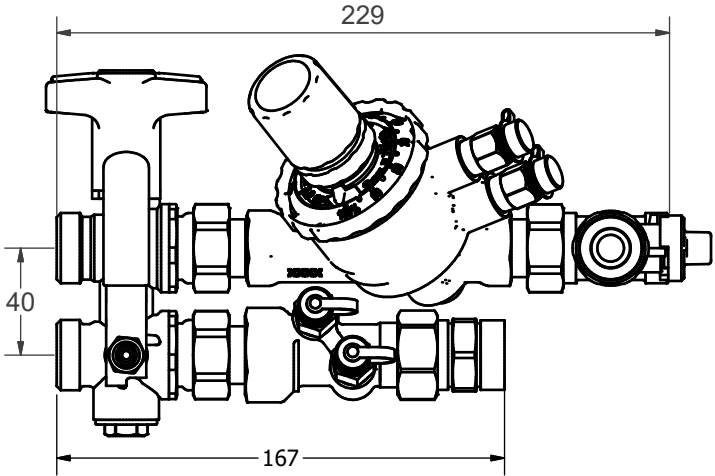


Assembly		
Type	PICV	Venturi [mm]
0X4B1RHRA0	PEB91VL.04	3
0X4B2RHRB0	PEB91L.04	4.25
0X4B2RHRC0	PEB91L.04	6
0X4B3RHRD0	PEB91H.04	7.5




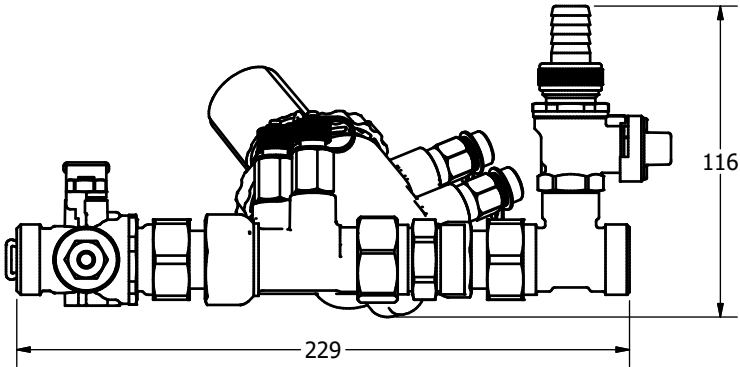


Revision	C	Issued	17/01/2020
----------	---	--------	------------

REVISION HISTORY		
REV	DESCRIPTION	DATE
A		20/10/18
B	B:Angles adjustment for H/K versions	
C	Moved drain to Return	24/11/2020

Discription		0X4 1/2" PICV & Drain in the Return, Venturi on flow Heating, Right, Vertical.	
 PETTINAROLI UK LTD RIVERSIDE UNIT K AUSTIN WAY, HAMSTEAD IND. ESTATE, BIRMINGHAM, B42 1DU. TEL: 0121 358 2012		Drawing No. 0X4BxRHRx0 Drawn By AC Sheet No 1 of 2	
		All Dim's in mm, General Tolerances Unless Stated. Dim's in Whole Units Toleranced ± 2.00mm Per Joint. Assembly To Be Leak Tested Underwater To 6 Bar Air.	

Assembly		
Type	PICV	Venturi [mm]
0X4B4RHRE0	PEB91L.06	9
0X4B5RHRF0	PEB91H.06	10.5

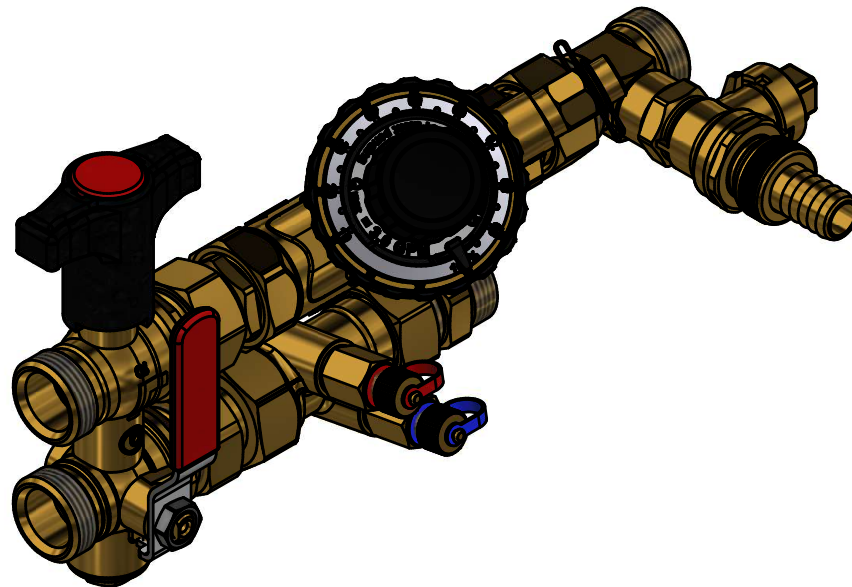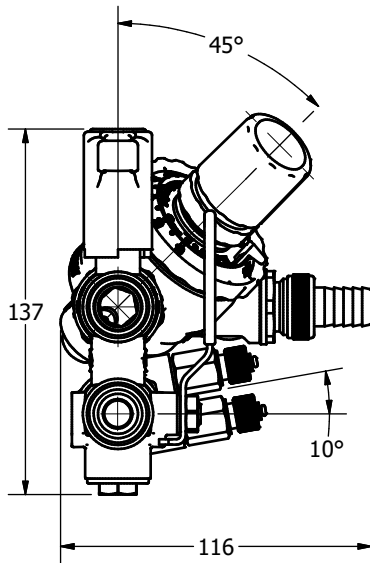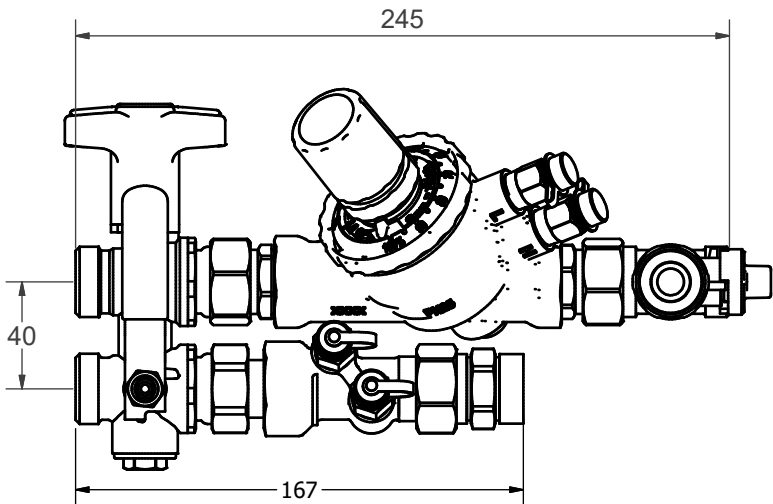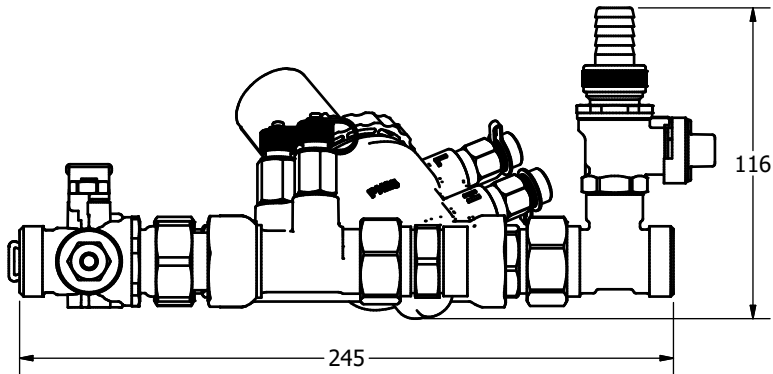

Revision	C	Issued	17/01/2020
----------	---	--------	------------

Discription	0X4 3/4" PICV & Drain in the Return, Venturi on flow Heating, Right, Vertical.		
-------------	--	--	--



PETTINAROLI UK LTD
RIVERSIDE UNIT K
AUSTIN WAY, HAMSTEAD IND. ESTATE,
BIRMINGHAM,
B42 1DU. TEL: 0121 358 2012

Drawing No.	0X4BxRHRx0 (3/4")		
-------------	-------------------	--	--

Drawn By	AC	Sheet No	2 of 2	All Dim's in mm, General Tolerances Unless Stated. Dim's in Whole Units Toleranced ± 2.00mm Per Joint. Assembly To Be Leak Tested Underwater To 6 Bar Air.
----------	----	----------	--------	--